

Landmark

ATM BUILDINGS


54



Features of the Landmark 54

- 14 Gauge Stainless Throughout
- Custom Vinyl Graphics
 - 5200 BTU Heater for Harsh Winter Conditions
 - Back-lit Advertising Panel on Front
 - Customized Designed for NCR ATMs
 - 5000 BTU Air Conditioner
 - Inside Servicing

LANDMARK 54 ELECTRICAL SPECIFICATIONS

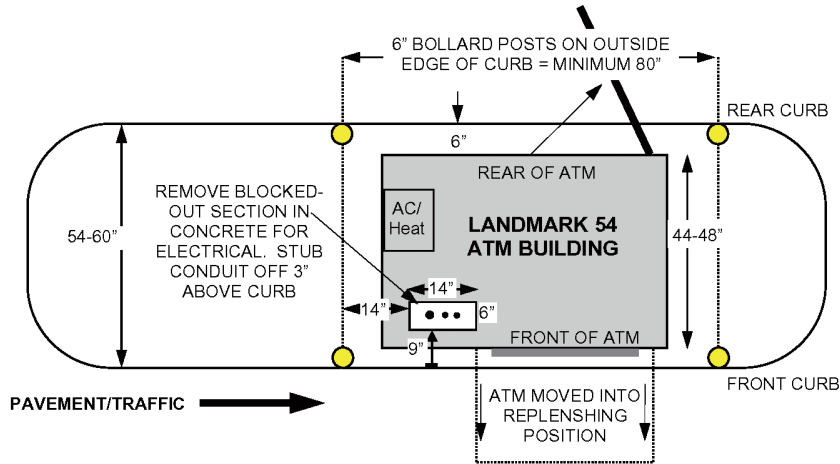

SPECIAL NOTE—CONCRETE SLAB MUST BE LEVEL

ELECTRICAL SPECIFICATIONS

3 PVC CONDUITS (MINIMUM REQUIREMENTS)

- 1" PVC FOR ELECTRICAL
- 1" PVC FOR SECURITY
- 1" PVC FOR DATA CIRCUIT

Electrician to supply 95-130 VAC 100 = 1% single phase 3 wire hookup. Un-switched individual branch circuits. (3) 6TW with 3rd wire earth ground. (conduit ground not acceptable). Requires 60 AMP service. KIOSK WILL HAVE AN ELECTRICAL BOARD WITH A 100 AMP MAIN BREAKER PANEL. ALL WIRING TO THE JOBSITE AND PANEL IS THE CUSTOMER'S RESPONSIBILITY.

100 AMP ELECTRICAL SUB-PANEL DIAGRAM

1	MAIN	100	2	A.C.	15
3		DP	4		DP
5	SPACE		6	GENERAL	15
7	SECURITY	15	8	DATA	15
9	SPACE		10	HEAT	15
11	ATM	20	12	HEAT	DP



Stainless Steel ATM Kiosk



701 Weaver Blvd. Anoka, MN 55303
Toll Free: 877-309-1048 Fax: 763-323-3374

www.caseandassociates.com