

Landmark

ATM BUILDINGS

77



Features of the Landmark 77


- 14 gauge construction throughout
- High gloss automotive-type finish with custom signage
 - Interior servicing - secure, environmentally-controlled
 - Large physical size. Reinforce branding/advertising
 - 3' canopy on front of kiosk - comfortable for ATM users
 - Back-lighting and down-lighting for better visibility
 - Accommodates any make or model ATM
 - No moving parts - Easier servicing
 - Can accommodate a commercial night depository



CASE

Foundation Specifications for Landmark 77 ATM Building

****SLAB MUST BE LEVEL****

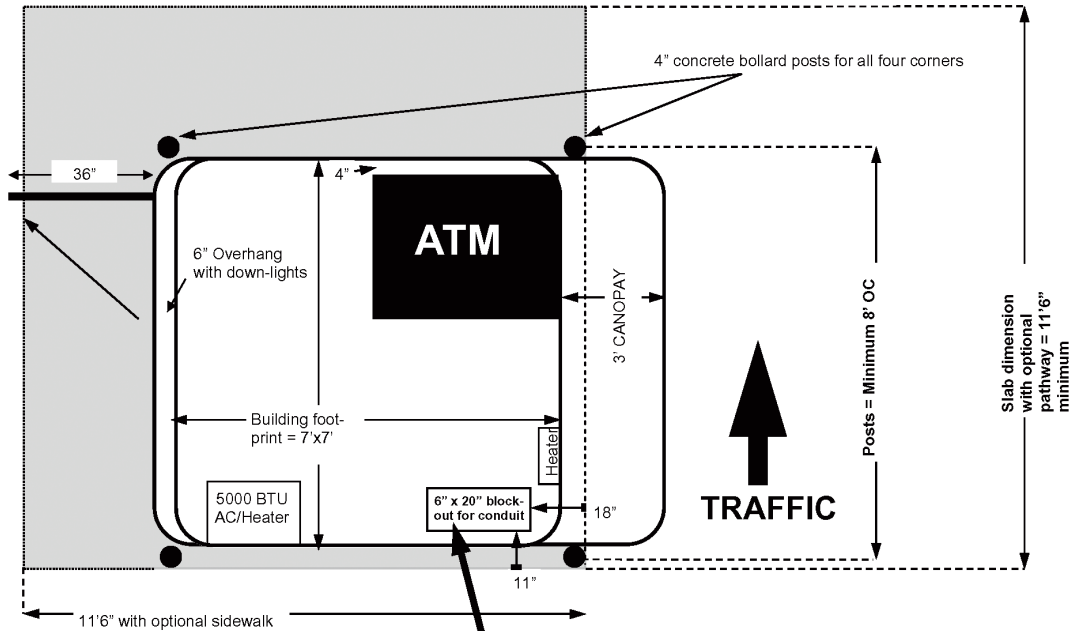

Electrician to supply 95-130 VAC 60 = 1% single phase 3 wire hookup. Un-switched individual branch circuits. (3) 10TW with 3rd wire earth ground. (conduit ground not acceptable). Requires 60 AMP service. CASE & ASSOCIATES WILL PROVIDE AN ELECTRICAL BOARD WITH A 60 AMP MAIN BREAKER PANEL. ALL WIRING TO THE JOBSITE AND PANEL IS THE CUSTOMER'S RESPONSIBILITY.

3 Conduits Needed Minimum

- 1" = Data
- 1" = Power
- 1" = Security



701 Weaver Blvd. Anoka, MN 55303
Toll Free: 877-309-1048 Fax: 763-323-3374

www.caseandassociates.com